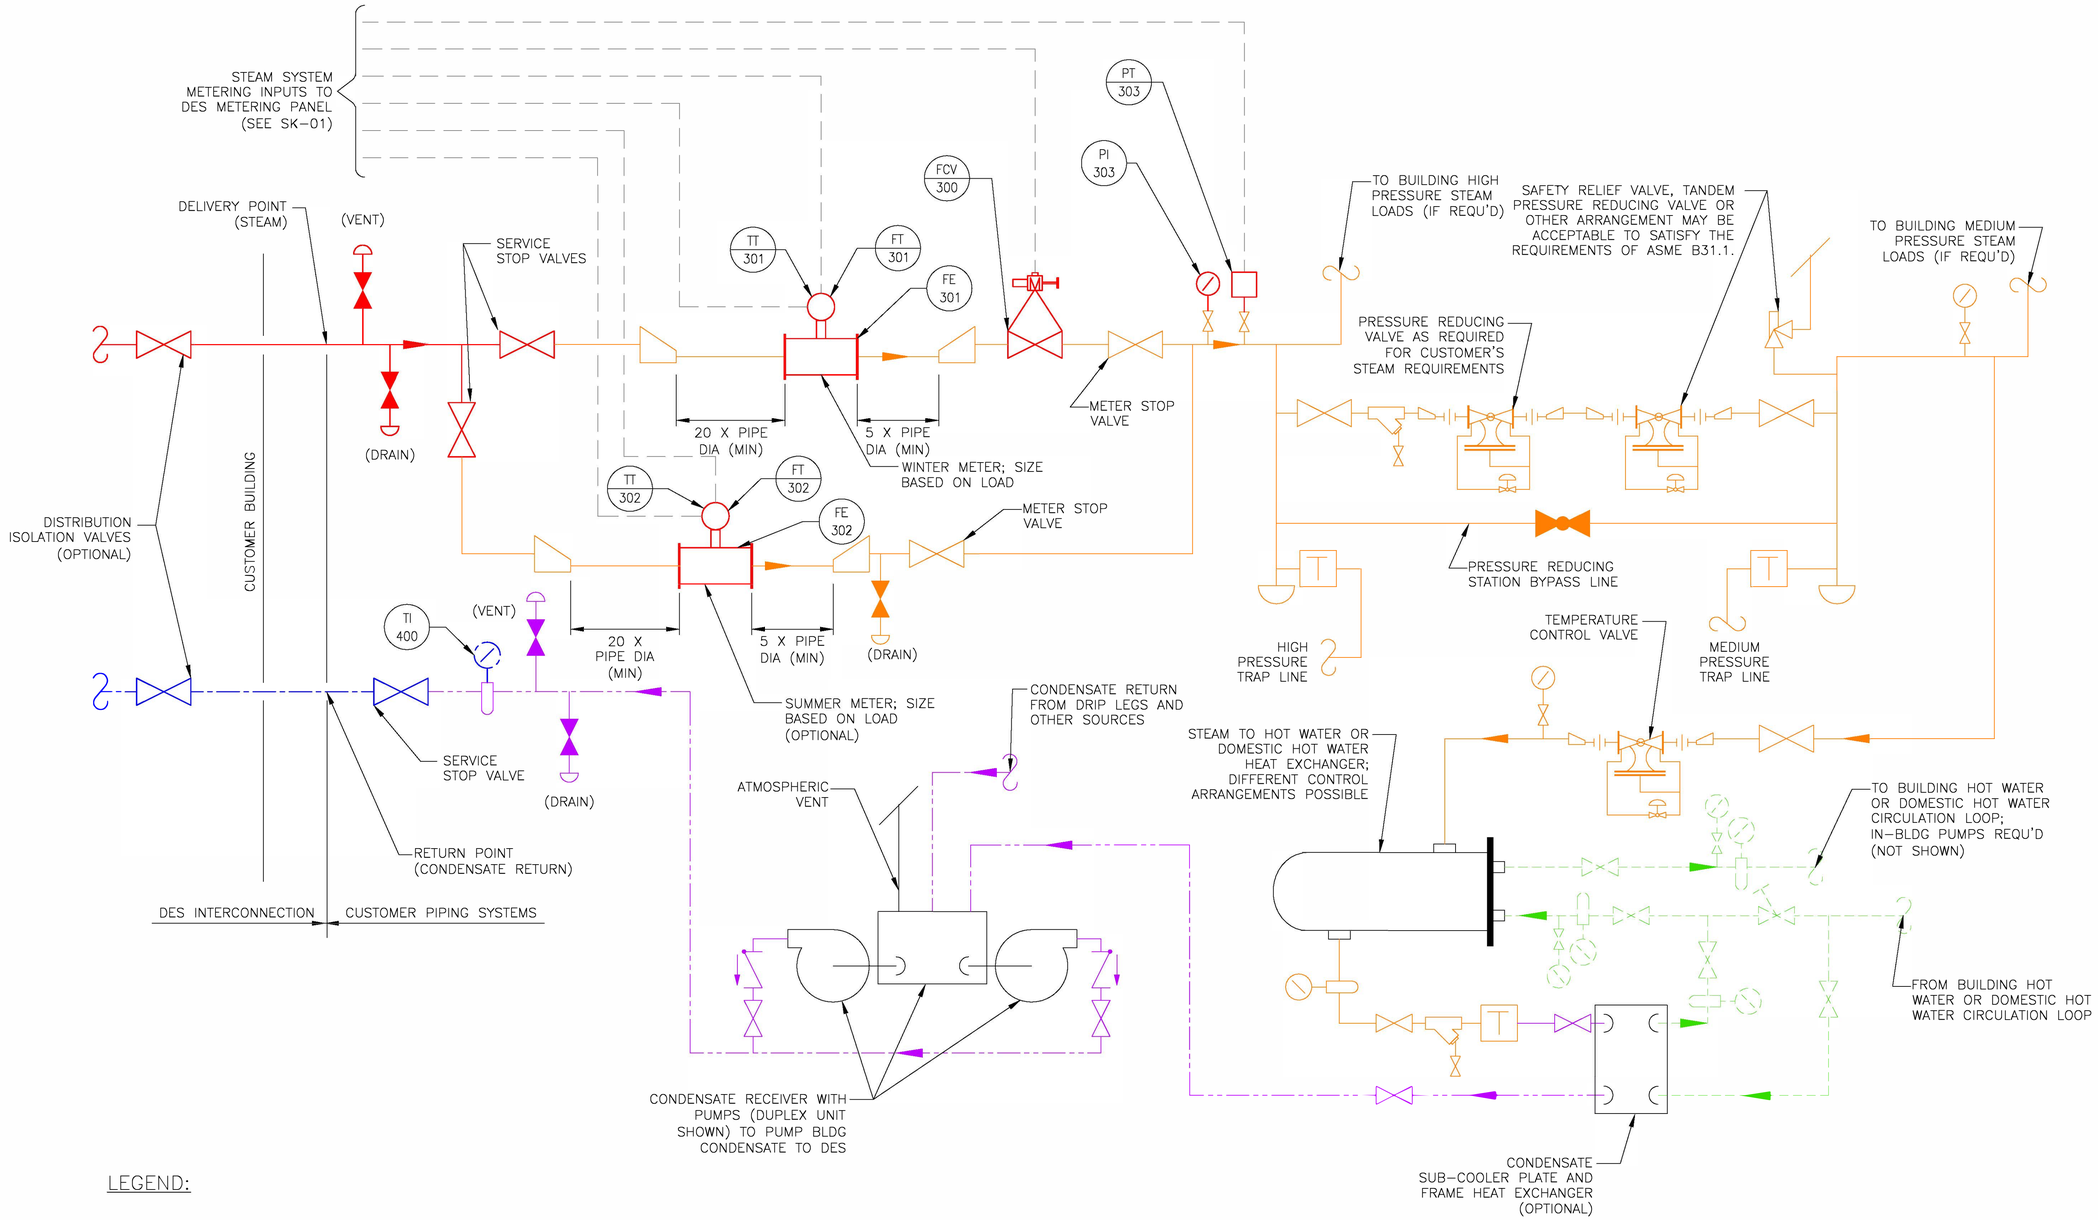

LEGEND:

- BLDG CONDENSATE (BLDG-SUPPLIED)
- BLDG HOT WATER (BLDG-SUPPLIED)
- BLDG STEAM (BLDG-SUPPLIED)
- DES CONDENSATE (DES-SUPPLIED)
- DES STEAM (DES-SUPPLIED)
- EQUIPMENT (BLDG-SUPPLIED)
- INSTRUMENTATION (DES-SUPPLIED)

NOTES:

1. ADDITIONAL INSTRUMENTATION, CONTROLS AND EQUIPMENT MAY BE REQUIRED ON THE CUSTOMER PIPING AND SYSTEM, PER THE CUSTOMER REQUIREMENTS, THAT ARE NOT SHOWN ON THIS SCHEMATIC.
2. DEVICES NOTED AS "OPTIONAL" MAY BE REQUIRED DEPENDING ON THE BUILDING LOAD, SPACE AVAILABILITY OR TECHNICAL REQUIREMENT.
3. IF SUMMER METER IS NOT REQUIRED BASED ON LOAD, FCV-300 IS NOT REQUIRED.
4. THE CUSTOMER PIPING AND EQUIPMENT SHOWN REPRESENTS THE GENERAL REQUIREMENTS. THE CUSTOMER IS RESPONSIBLE FOR THE DESIGN AND ENGINEERING OF THEIR PIPING AND EQUIPMENT.
5. ADDITIONAL DRIP LEGS AND TRAP LINES MAY BE REQUIRED.

PRELIMINARY

PLOT DATE : 01/07/2011

THERMAL ENGINEERING GROUP, INC.
P.O. BOX 290 * HENDERSONVILLE, TN 37075

METRO NASHVILLE DISTRICT ENERGY SYSTEM

TYPICAL STEAM CUSTOMER CONNECTION

Metro Nashville DISTRICT ENERGY SYSTEM

DES PROJECT NO. XXX

PRELIMINARY

REVISIONS

NO.	DATE	DESCRIPTION

DRAWN BY:	APP'D. BY:	CHECKED:
KLJ		
DATE: 01/05/11	DATE:	DATE:

PROJECT NO. 863.07XX

DRAWING NO. SK-02